


# LED Economy High Bay

## 12,000LM - 50,000LM | 5000K

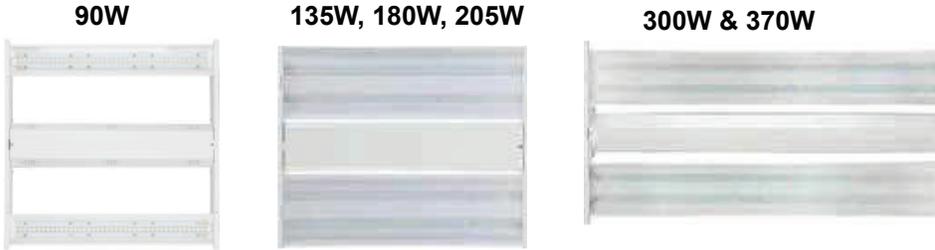

### Features

- Rugged die-cast aluminum
- Corrosion resistant housing
- White coat finish
- LM-80 certified high performance lumileds LEDs
- Universal 120-277 VAC or 377-480 VAC input voltage
- **(Special Order)**
- CRI 80
- Can be mounted on a standard j-box, conduit, or suspended with included steel cable

### Warranty & Listings

- 0-10V Dimming
- 5-year warranty
- UL listed
- DLC


### Dimensions

**90W**  
23.6"(L) x 9.9"(W) x 1.8"(H)

**135W**  
23.9"(L) x 19.7"(W) x 1.8"(H)

**180W & 205W**  
23.6"(L) x 15.8"(W) x 1.8"(H)

**300W & 370W**  
47.6"(L) x 24"(W) x 2.9"(H)

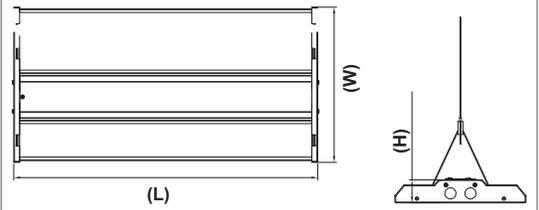

Product No	Description	Accessories	W MH
HBL22D095W27V50K-FD-1	2' x 2' - 90 Watt - 12,000 Lumens - 5000K	As is, no accessories	175W MH
HBL22D135W27V50K-FD	2' x 2' - 135 Watt - 18,500 Lumens - 5000K	As is, no accessories	250W MH
HBL22D135W48V50K-FD	2' x 2' - 135 Watt - 18,500 Lumens - 5000K	Driver for 480V	250W MH
HBL22D135W27V50K-FD-PIR	2' x 2' - 135 Watt - 18,500 Lumens - 5000K	Occupancy Sensor	250W MH
HBL22D135W27V50K-FD-EM	2' x 2' - 135 Watt - 18,500 Lumens - 5000K	Emergency Battery	250W MH
HBL22D180W27V50K-FD	2' x 2' - 180 Watt - 23,400 Lumens - 5000K	As is, no accessories	400W MH
HBL22D180W48V50K-FD	2' x 2' - 180 Watt - 23,400 Lumens - 5000K	Driver for 480V	400W MH
HBL22D180W27V50K-FD-PIR	2' x 2' - 180 Watt - 23,400 Lumens - 5000K	Occupancy Sensor	400W MH
HBL22D180W27V50K-FD-EM	2' x 2' - 180 Watt - 23,400 Lumens - 5000K	Emergency Battery	400W MH
HBL22D205W27V50K-FD	2' x 2' - 205 Watt - 27,000 Lumens - 5000K	As is, no accessories	400W MH
HBL24D330W27V50K-FD	2' x 4' - 300 Watt - 40,000 Lumens - 5000K	As is, no accessories	1000W MH
HBL24D320W48V50KHMD	2' x 4' - 300 Watt - 40,000 Lumens - 5000K	Driver for 480V	1000W MH
HBL24D320W27V50KHMD-PIR	2' x 4' - 300 Watt - 40,000 Lumens - 5000K	Occupancy Sensor	1000W MH
HBL24D320W27V50KHMD-EM	2' x 4' - 300 Watt - 40,000 Lumens - 5000K	Emergency Battery	1000W MH

Product No	Description	Accessories	W MH
HBL24D370W27V50KBMD	2' x 4' - 370 Watt - 50,000 Lumens - 5000K	As is, no accessories	1000W+ MH
HBL24D370W48V50KBMD	2' x 4' - 370 Watt - 50,000 Lumens - 5000K	Driver for 480V	1000W+ MH
HBL24D370W27V50KBMD-PIR	2' x 4' - 370 Watt - 50,000 Lumens - 5000K	Occupancy Sensor	1000W+ MH
HBL24D370W27V50KBMD-EM	2' x 4' - 370 Watt - 50,000 Lumens - 5000K	Emergency Battery	1000W+ MH

## LED Shop Light 4,200LM | 4000K



### Warranty & Listings


- cETLus - Damp location
- 5-year warranty
- RoHS
- FCC
- ANSI/IEEE C62.41, surge immunity protection (2.5kV)

### Features

- Available in 4000K (cool white)
- 50,000 hours of operation
- 4,200 lumens & draws 40 watts (110 lumens per watt)
- Uniform illumination with no visible LED pixilation
- 120 AC voltage (50-60Hz) is standard. Connects up to 8 shop lights
- Mounts using standard, 3-foot chains
- On/off pull-chain (18" long) is standard
- Power factor > 0.90
- Total harmonic distortion < 20%
- Color rendering index > 80
- Polycarbonate lens

### Dimensions

**40W**  
48 "(L) x 3"(W) x 2"(H)

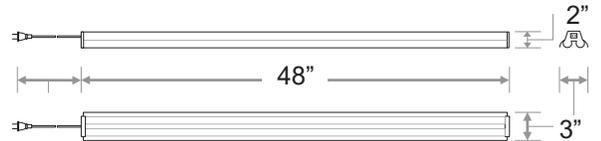

Product No	Description	Accessories	W MH
LEDSHOPLITE-40W-4K	4' - 40 Watt - 4,200 Lumens - 4000K	As is, no accessories	110W MH

## Wireless Lighting Control System

G5 Smart wireless lighting control system is an indoor or outdoor control system for parking lots, street, roadway and commercial lights. The unique technology inside the system enables customer to remote monitor and operate all fixtures through a Web-enabled central management system. Customers can use any Internet enabled equipment such as smart phones, computer or tablets to access the user portal of the system. **(Special Order)**



**Lighting Fixture**  
Highly efficient LED fixtures.



**Smart Energy Monitor**  
Low-Voltage powered module. Power modules create safe low-voltage circuits to power and control LED lighting fixture.



**Smart Gateway**  
Stores and transmits real-time building usage data.



**Software Services**  
Mobile & Web application.


## Electrical Data

Number Of Drivers	Driver Current (mA)	Nominal Power (W)	INPUT VOLTAGE (V)	CURRENT (Amps)
1	2270	90	120	0.75
		90	208	0.43
		90	240	0.38
		90	277	0.32
	2400	90	347	0.26
		90	480	0.19
2	3040	130	120	1.08
		130	208	0.63
		130	240	0.54
		130	277	0.47
	3200	130	347	0.37
		130	480	0.27
2	4540	180	120	1.50
		180	208	0.87
		180	240	0.75
		180	277	0.65
		190	347	0.55
		190	480	0.40
2	5200	205	120	1.71
		205	208	0.99
		205	240	0.85
		205	277	0.74
		210	347	0.61
		210	480	0.44
4	6520	270	120	2.25
		270	208	1.30
		270	240	1.13
		270	277	0.97
	6400	270	347	0.78
		270	480	0.56
4	7200	300	120	2.50
		300	208	1.44
		300	240	1.25
		300	277	1.08
	7400	300	347	0.86
		300	480	0.63

# RC-100 Sensor Remote Programmer OPERATION INSTRUCTIONS

## SPECIFICATIONS

Power supply	2 x AAA 1.5V battery, Alkaline preferred
Carrying case	RC-100 in carrying case
Upload range	Up to 15 m (50 ft.)
Op. temperature	0°C~50°C (32°F~122°F)
Dimensions	123x70x20.3 mm (4.84" x 2.76" x 0.8")

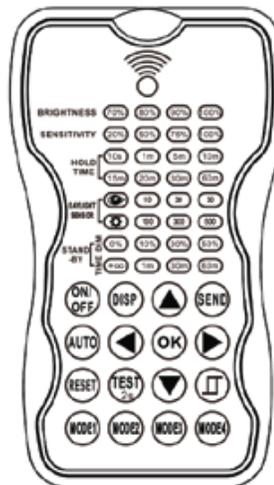

## WARNING

Remove the batteries from compartment if the remote will not be used in 30 days.

## OVERVIEW

The remote control Wireless IR Configuration Tool is a handheld tool for remote configuration of IR-enabled fixture integrated sensors. The tool enables device to modify via pushbutton without ladders or tools, and stores up to four sensor parameter modes to speed configuration of multiple sensors.

The remote control uses bidirectional IR communication to send and receive sensor settings at mounting height up to 50 feet. The device can display previously established sensor parameters, copy parameters and send new parameters or store parameter profiles. For projects where identical settings may be desired across a large number of areas or spaces, this capability provides a streamlined method of configuration. Settings can be copied throughout a site, or in different sites.

## LED INDICATORS

LED	DESCRIPTION	LED	DESCRIPTION
BRIGHTNESS	High end trim turning function(To Set the output level of connected lighting during occupancy)		To select the current surrounding lux value as the daylight threshold. This feature enables the fixture to function well in any real application circumstances.
SENSITIVITY	To set the occupancy sensing sensitivity of the Sensor		The daylight sensor stops working, and all motion detected could turn on the lighting fixture, no matter how bright the natural light is.
HOLD TIME	The time that the Sensor will turn off(if you choose stand-by level is 0) or dim the light to a low level after the area is vacated	STAND-BY DIM	To set the output level of connected lighting during vacancy. The sensor will regulate the lighting output at the set level. Setting the STAND-BY DIM level at 0 means light full off during vacancy.
DAYLIGHT SENSOR	To represents various thresholds of natural light level for the Sensor .	STAND-BY TIME	To represents the time that the Sensor will keep the light at low dim level after the HOLD TIME elapsed.

# BUTTON OPERATION

BUTTON	DESCRIPTION	BUTTON	DESCRIPTION
	Press the  button, the light goes to permanent on or permanent off mode, and the sensor is disabled. (MUST press  button to quit this mode for Setting.		Press  button, the sensor starts to function and all settings remain the same as the latest status before the light is switched on/off.
	Display the current/latest setting parameters in LED indicators(the LED indicators will on for showing the setting parameters).		The button  is for testing purpose sensitivity only. after you choose sensitivity thresholds, then you press  button, The sensor goes to test mode(hold time is only 2s) automatically ,meanwhile the stand-by period and daylight sensor are disabled. Press  button to quit from this mode.
	Press  button, all settings go back to settings of dip Switch in sensor.		
	Enter in the setting condition, the parameter leds of remote control will flash to be selected. and Navigate to UP and Down for choose selected parameters in LED indicators.		Navigate to LEFT and RIGHT for choose selected parameters in LED indicators.
	Confirm the selected parameters selected parameters in remote control.		Open and close smart daylight Sensor. Press  Enter in the setting condition, the parameter leds of remote control will flash to be selected, Press  for open or close smart daylight Sensor.
	Press  button, upload the current parameters to sensor(s), the led light which the sensor connects will on/off as confirm.		
	4 Scene modes with preset parameters which are available to be changed and saved in modes.		

## SETTING

The SETTING Content contains all available settings and parameters for remote sensors. It allows you to change the available control, parameters, and operation of the sensor from factory default or current parameters.

### Change multiple settings of sensor(s)

1.Press button, the remote control leds will show the latest parameters you set.

**NOTE:** if you push button before, you must push button to unlock the sensor.

2.Press enter in the setting condition, the parameter leds of remote control will flash to be selected, navigate to the desired setting by pressing to select the new parameters.

3.Press ok to confirm all setting and saving.

4.Aim at the target sensor and press to upload the new parameter, the led light which the sensor connects will on/off as confirm.

**NOTE:** the setting works key step is by Push , enter in the setting condition.

**NOTE:** the led light which the sensor connects will on/off after getting the new parameter as confirm.

**NOTE:** If you press button, the remote led indicators will show the latest parameters which were sent.

## Change multiple setting of sensors with smart photocell sensor Open

1. Press **DISP**, the remote led indicators will show the latest parameters.
2. Press **▲** or **▼** enter in the setting condition, the parameter Led indicators of remote control will flash to be selected.
3. Press **□**, 2 led indicators will flash in daylight sensor settings, select daylight **10** **30** **50** as setpoint to light on Automatically, select daylight **100** **300** **500** as setpoint to light off Automatically.
4. Press **OK** to confirm all setting and saving.
5. Aim at the target sensor and press **SEND** to upload the new parameter. The led light which the sensor connects will on/off.

**NOTE:** **□** is disabled by default.


1. Open or close the smart daylight sensor by push **□** when remote control is in setting condition.
2. When the smart daylight sensor open, 2 Led indicators are flash in daylight sensor setting. select daylight **10** **30** **50** as setpoint to light on Automatically, select daylight **100** **300** **500** as setpoint to light off automatically. When smart daylight sensor close, 1 Led indicator is flash in the daylight sensor setting for choose daylight sensor threshold.
3. When the smart daylight sensor open, the stand-by time is only **+∞**.
4. Smart daylight sensor takes place of normal photocell sensor and works independently.
5. See **Daylight Sensor Function**.

## Corridor Function


This function inside the motion sensor to achieve tri-level control, for some areas which require a light change notice before switch-off. The sensor offers 3 levels of light: 100%-->dimmed light (natural light is insufficient) -->off; and 2 periods of selectable waiting time: motion hold-time and stand-by period; Selectable daylight threshold and freedom of detection area.



With sufficient natural light, the light does not switch on when presence is detected.



With insufficient natural light, the sensor switches on the light automatically when presence is detected.



After hold-time, the light dims to stand-by level if the surrounding natural light is below the daylight threshold.



Light switches off automatically after the stand-by period elapses.

## Daylight Sensor Function


Open the daylight sensor by push **□** when remote control is in setting condition.



The light switches on at 100% when there is movement detected.



The light dims to stand-by level after the hold-time.




The light remains in dimming level at night.

Settings on this demonstration:

Hold-time: 30min  
 setpoint to light on: 50lux  
 setpoint to light off: 300lux  
 Stand-by Dim: 10%  
 Stand-by period: +∞  
 (when the smart photocell sensor open, the stand-by time is only +∞)


● ← ● → goes in cycle at night ...  
100% on when movement detected, and dims to 10% in long absence.



When the natural light level exceeds setpoint off to light, the light will turn off even if when the space is occupied.



The light automatically turns on at 10% when natural light is insufficient (no motion).

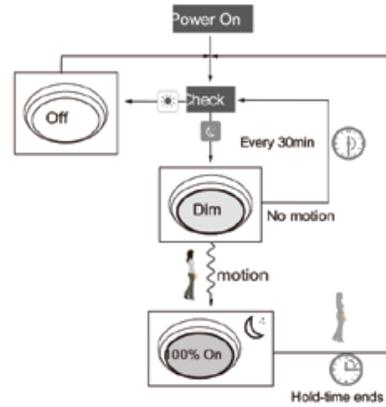

### Corridor Function VS Daylight Sensor Function.

1. In corridor function, turn on the light MUST by natural light level lower daylight sensor setting and Occupancy. In smart daylight sensor function, turn on the light by natural light level lower daylight setpoint to light on even if vacancy.
2. In corridor function, turn off light by stand-by time finish if vacancy. In smart daylight sensor function, turn off the light by natural light level higher than daylight setpoint to light off even if occupancy.
3. In smart daylight sensor function, natural light level lighter/lower than daylight setpoint to light off/on MUST keep at least 1 minute, that will turn off/on the light automatically.

### About RESET and MODE(1,2,3,4)

The remote control comes with 4 Scene MODES which are not default. You may make desired parameters and save as the new MODE(1,2,3,4) to configure the installed sensors.

**RESET:** all settings go back to settings of DIP Switch in sensor.

### SCENE MODES(1 2 3 4)

MODE	BRIGHTNESS	SENSITIVITY	HOLD TIME	DAYLIGHT SENSOR	STAND-BY DIM	STAND-BY TIME
MODE1	70%	20%	10s		0%	+∞
MODE2	70%	20%	10s		0%	+∞
MODE3	70%	20%	10s		0%	+∞
MODE4	70%	20%	10s		0%	+∞

Change the MODES:

1. press / / / button, the remote control Led indicators show existing parameters.
2. press / / / to select the new parameters.
3. Press to confirm all parameters and saving in the mode.

### UPLOAD

The upload function allows you to configure the sensor with all parameters in one operation. You may select CURRENT SETTING parameters or the MODE for uploading. Current setting parameters or the MODE are displayed in Remote control.

### Upload the current parameters to sensor(s), and duplicate the sensor parameters form one to another

1. Press button or press / / / , all parameters are displayed in Remote control.

**Note:** check if all parameters are correct, if not, change them.

2. Aim at the sensor and press button, the light that sensor connects will be on/off as confirm.

**Note:** if other sensor need same parameters, just aim at the sensor and press button.